

Bradwell Abbey – Newport

 DNOA Decision
Remove

Scheme description

Under a FCO condition the entire Newport Pagnell demand and half the Fox Milne demand is supplied by one 33 kV circuit. To create further capacity, two 33 kV circuits from Bradwell Abbey to the Fox Milne/Hanslope Park tees are being installed, in order to provide clean feeds from Bradwell Abbey to Fox Milne, Hanslope Park and both transformers at Newport Pagnell.



Constraint Season
None



Flexibility Product
Secure

Justification for decision


Reinforcement works are near completion and there is currently no constraint requiring flexibility to manage.

Constraint management timeline

2023 H1 **None**
 2022 H2 Signposting
 2022 H1 Signposting
 2021 H2 Signposting
 2021 H1 Signposting

Estimated flex utilisation required per year (MWh):

	2023	2024	2025	2026	2027
BV					
CT					
LTW					
ST					
SP					

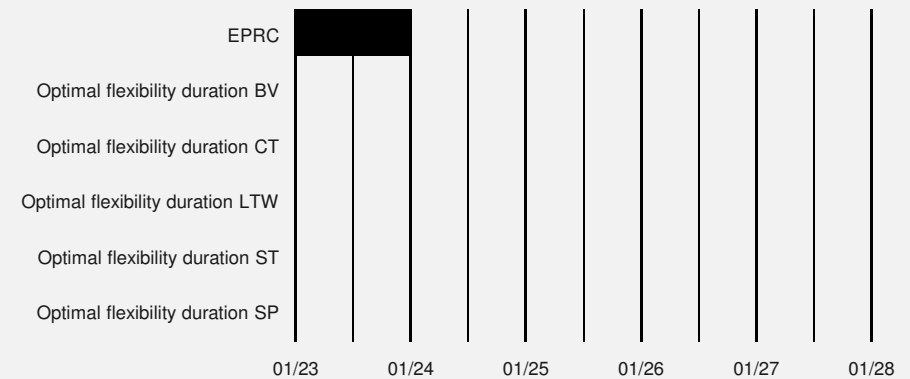

For more information visit: nationalgrid.co.uk/network-flexibility-map-application