

Hawton

 DNOA Decision
Remove

Scheme description

The Hawton tee - Hawton 132 kV circuits are constrained due to generation growth. The existing Hawton tee - Hawton 132 kV circuits are limited by the existing overhead line. It is proposed to re-string a section of 132 kV double circuit overhead line.



Constraint Season
None



Flexibility Product
Secure

Justification for decision


Constraint no longer an issue until at least 2027 under every scenario.

Constraint management timeline

- 2023 H1 **None**
- 2022 H2 Maintain Active
- 2022 H1 Maintain Active
- 2021 H2 Maintain Active
- 2021 H1 Maintain Active
- 2020 H2 Procurement

Estimated flex utilisation required per year (MWh):

	2023	2024	2025	2026	2027
BV					
CT					
LTW					
ST					
SP					

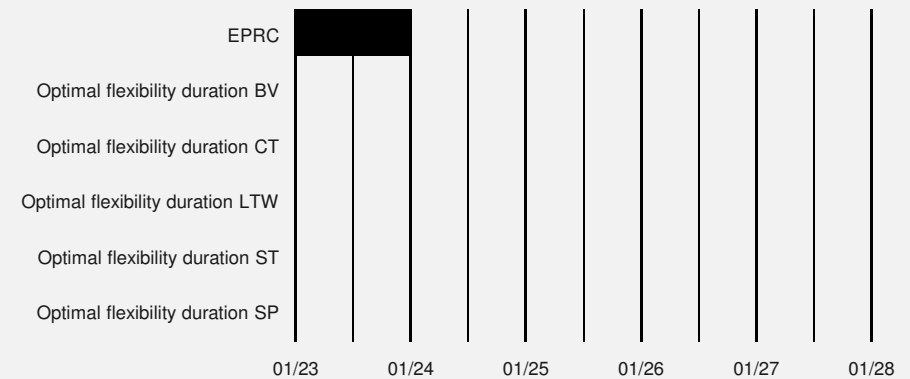

For more information visit: nationalgrid.co.uk/network-flexibility-map-application