

# Bushbury

 DNOA Decision  
**Remove**

## Scheme description

Bushbury is a 132/11 kV site consisting of three transformers.

Constraint here is the flow through two of the three transformers following an outage on the third.



Constraint Season  
**None**



Flexibility Product  
**Secure**



## Justification for decision


Constraint no longer an issue until at least 2027 under every scenario.

## Constraint management timeline

**2023 H1** None  
**2022 H2** Signposting  
**2022 H1** Signposting  
**2021 H2** Signposting  
**2021 H1** Signposting  
**2020 H2** Signposting  
**2020 H1** Signposting  
**2019 H2** Signposting

## Estimated flex utilisation required per year (MWh):

	2023	2024	2025	2026	2027
<b>BV</b>					
<b>CT</b>					
<b>LTW</b>					
<b>ST</b>					
<b>SP</b>					

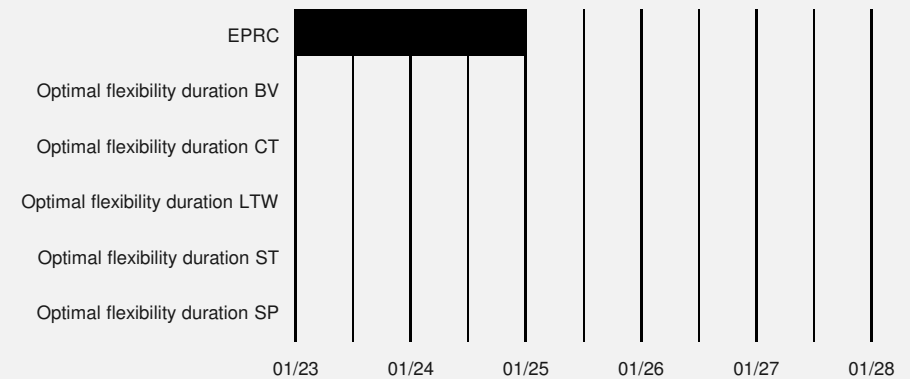

For more information visit: [nationalgrid.co.uk/network-flexibility-map-application](https://nationalgrid.co.uk/network-flexibility-map-application)