

# Western Approach

 DNOA Decision  
**Remove**

## Scheme description

Following the connection of further demand the firm transformer capacity was projected to be exceeded at some point at Western Approach PSS. 11 kV works are proposed to deal with this constraint.



Constraint Season  
**None**



Flexibility Product  
**Secure**

## Justification for decision


Constraint no longer an issue until at least 2027 under every scenario.

## Constraint management timeline

- 2023 H1 **None**
- 2022 H2 Signposting
- 2022 H1 Signposting
- 2021 H2 Signposting
- 2021 H1 Signposting

## Estimated flex utilisation required per year (MWh):

	2023	2024	2025	2026	2027
BV					
CT					
LTW					
ST					
SP					

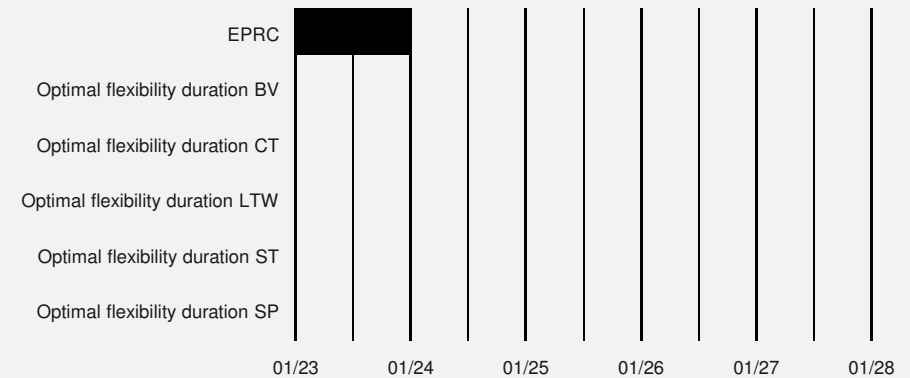

For more information visit: [nationalgrid.co.uk/network-flexibility-map-application](https://nationalgrid.co.uk/network-flexibility-map-application)