

Ashgrove

DNOA Decision
Signposting

Scheme description

Ashgrove primary is a 33/11 kV site with two transformers. For an N-1 scenario for the loss of one of the transformers the other supplies the full demand. Growth projections indicate the demand at Ashgrove will exceed the rating of one transformer in the near future. Proposed reinforcement is to uprate the transformers at Ashgrove.



Constraint Season
Winter



Flexibility Product
Secure

Justification for decision


No flexibility requirement under Best View until 2026.

Constraint management timeline

2023 H1 **Signposting**

Estimated flex utilisation required per year (MWh):

	2023	2024	2025	2026	2027
BV				0.93	1.44
CT				0.93	1.44
LTW			1.04	1.88	10.34
ST					
SP					

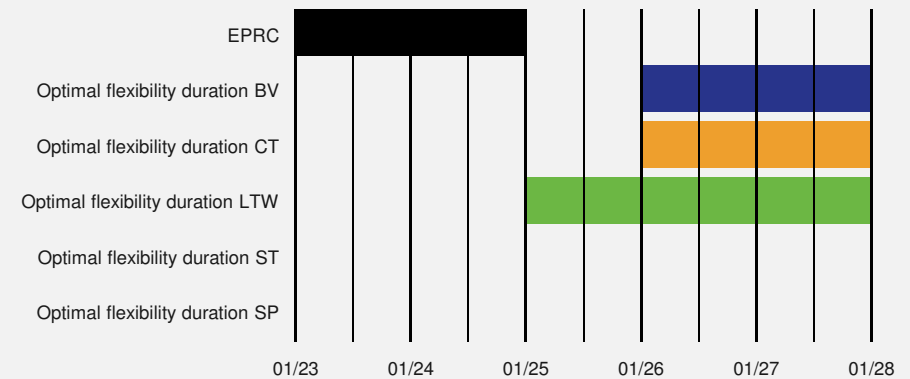

For more information visit: nationalgrid.co.uk/network-flexibility-map-application