

Honiton Heathfield and Offwell Ring


 DNOA Decision
Signposting

Scheme description

An N-1 condition for the loss of one of the 33 kV circuits towards Offwell and Honiton primaries. Demand forecasts indicate this outage will overload this circuit at some point in the near future. The proposed reinforcement solution is to uprate the limiting section of circuit.



Constraint Season
Winter



Flexibility Product
Secure

Justification for decision


No flexibility requirement under any scenario until 2027.

Constraint management timeline

2023 H1 **Signposting**

Estimated flex utilisation required per year (MWh):

	2023	2024	2025	2026	2027
BV					
CT					
LTW					110.33
ST					
SP					

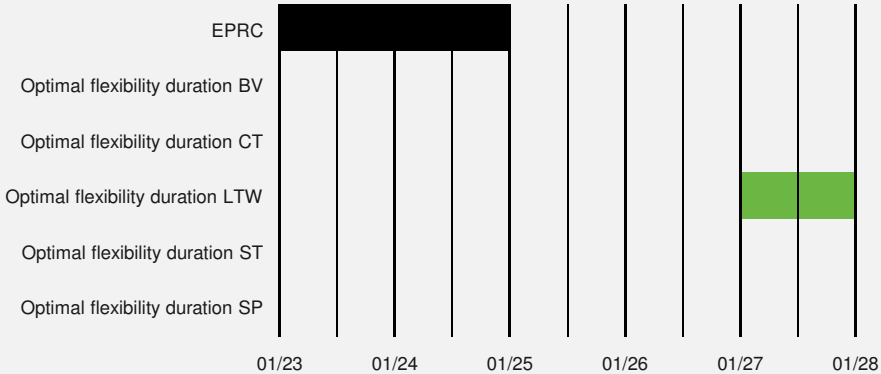

For more information visit: nationalgrid.co.uk/network-flexibility-map-application