

Barnstaple – South Molton


 DNOA Decision
Signposting

Scheme description

An N-1 outage on one of the 33 kV circuits feeding Heddon Cross, Aaronsons and South Molton primaries leaves the full demand on the remaining circuit. Demand forecasts indicate this outage will overload this circuit at some point in the near future. The proposed reinforcement solution is to uprate the limiting section of circuit.



Constraint Season
Winter



Flexibility Product
Secure

Justification for decision


No flexibility requirement under any scenario until at least 2026.

Constraint management timeline

2023 H1 Signposting

Estimated flex utilisation required per year (MWh):

	2023	2024	2025	2026	2027
BV					
CT					9.51
LTW				1.17	
ST					
SP					

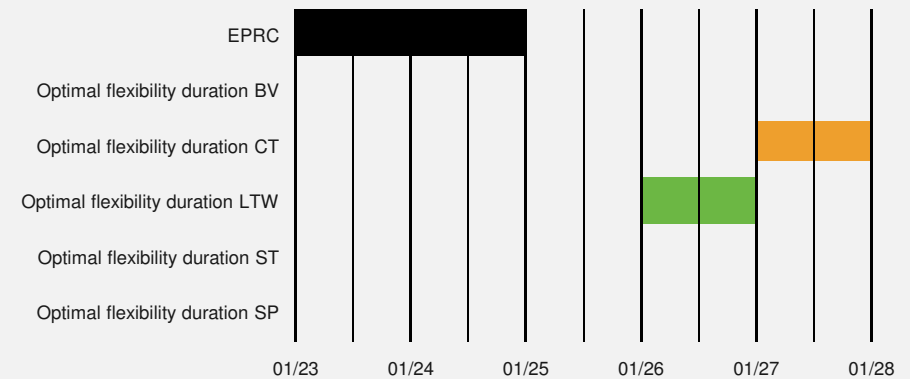

For more information visit: nationalgrid.co.uk/network-flexibility-map-application