

Blagdon

 DNOA Decision
Signposting

Scheme description

Under intact running the peak load at Blagdon primary (a single transformer site) is near to the rating of its transformer. The proposed reinforcement solution is to install a second 33/11 kV transformer at Blagdon.



Constraint Season
Winter



Flexibility Product
Secure

Justification for decision


No flexibility requirement under any scenario until 2027.

Constraint management timeline

2023 H1 Signposting

Estimated flex utilisation required per year (MWh):

	2023	2024	2025	2026	2027
BV					
CT					
LTW					0.93
ST					
SP					

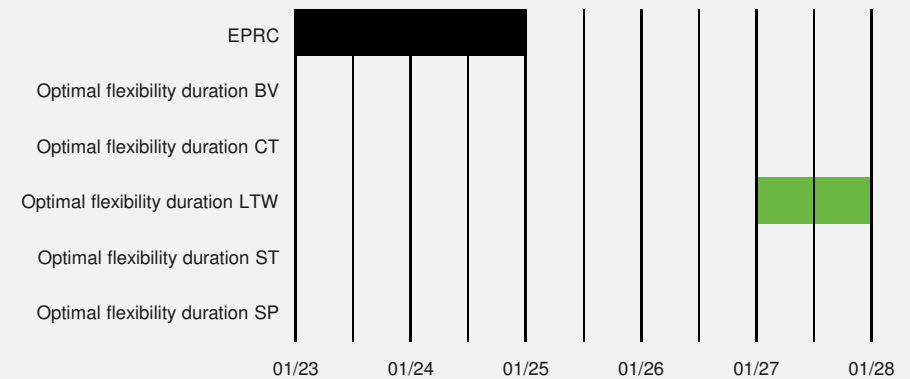

For more information visit: nationalgrid.co.uk/network-flexibility-map-application