

Hayle BSP


 DNOA Decision
Signposting

Scheme description

Hayle BSP is close to its firm capacity for an N-1 outage on one of its GTs. The proposed reinforcement solution is to uprate both GTs at Hayle BSP.



Constraint Season
Winter



Flexibility Product
Secure

Justification for decision


No flexibility requirement under any scenario until 2027.

Constraint management timeline

2023 H1 Signposting

Estimated flex utilisation required per year (MWh):

	2023	2024	2025	2026	2027
BV					28.68
CT					
LTW					28.68
ST					
SP					

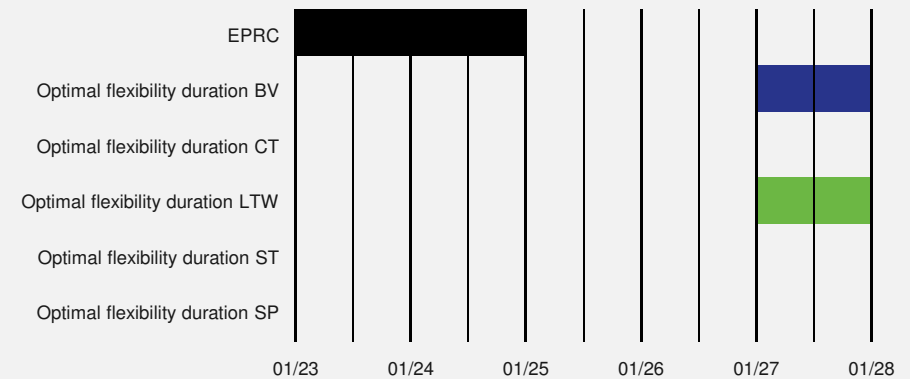

For more information visit: nationalgrid.co.uk/network-flexibility-map-application