

# Abergavenny - Crickhowell

 DNOA Decision  
**Signposting**

## Scheme description

The northern 66 kV ring in Mid Wales is supplied by two 66 kV circuits from Abergavenny. Either circuit is close to becoming overloaded following a FCO. Additionally, forecast demand growth will exacerbate existing voltage regulation issues on the 66 kV network during FCO conditions. Proposed solution is to install a new 132 kV circuit from Rassau to feed a new 132/66 kV BSP to be established near Brecon.



Constraint Season  
Winter/Summer



Flexibility Product  
Dynamic



## Justification for decision


No flexibility requirement under any scenarios until at least 2026.

## Constraint management timeline

- 2022 H2 **Signposting**
- 2022 H1 Signposting
- 2021 H2 Signposting
- 2021 H1 Signposting

## Estimated flex utilisation required per year (MWh):

	2022	2023	2024	2025	2026
BV					
CT					
LTW					
ST					
SP					

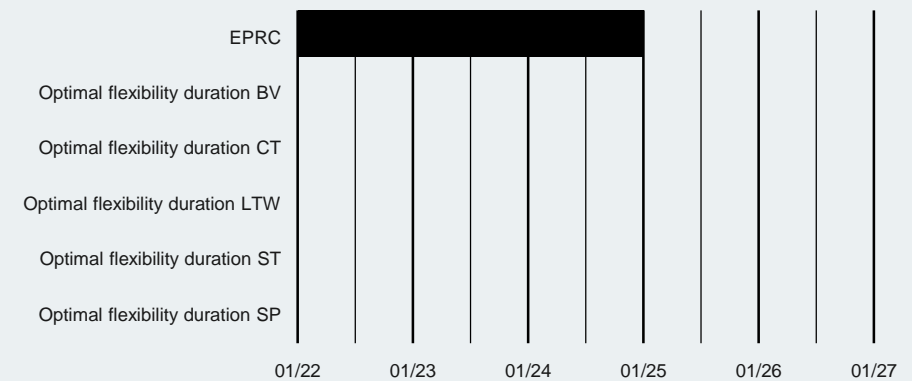

For more information visit: [www.westernpower.co.uk/network-flexibility-map-application](http://www.westernpower.co.uk/network-flexibility-map-application)