

Smethwick



DNOA Decision
Signposting

Scheme description

Smethwick is a 132/11 kV site consisting of three transformers fed via three 132 kV circuits from Bustleholm GSP.

It's likely in the future that two transformers may overload when the third is on outage.



Constraint Season
None



Flexibility Product
Secure



Justification for decision


No flexibility requirement under any scenarios until at least 2026.

Constraint management timeline

- 2022 H2 **Signposting**
- 2022 H1 Signposting
- 2021 H2 Signposting
- 2021 H1 Signposting
- 2020 H2 Maintain Active
- 2020 H1 Maintain Active
- 2019 H2 Procurement

Estimated flex utilisation required per year (MWh):

	2022	2023	2024	2025	2026
BV					
CT					
LTW					
ST					
SP					

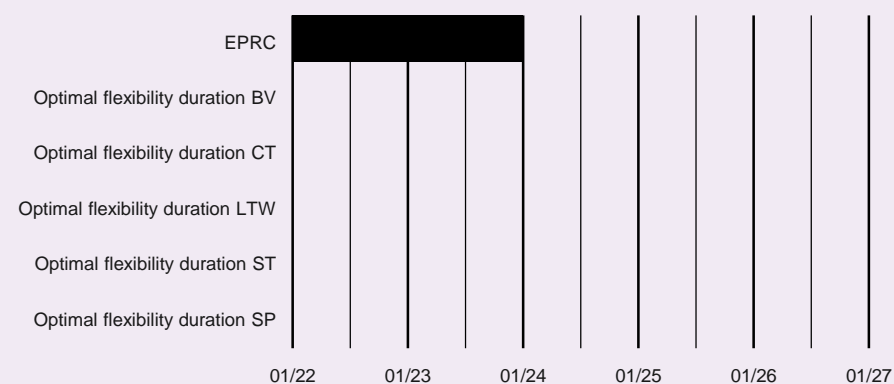

For more information visit: www.westernpower.co.uk/network-flexibility-map-application