

Company Directive

ENGINEERING SPECIFICATION EE SPEC: 142

Earthing and Auxiliary Transformers

Policy Summary

The specification covers Western Powers requirements for earthing and Auxiliary transformers for use on its network.

Author: Andrew Reynolds

Implementation Date: April 2019

Approved by



Policy Manager

Date:

1 May 2019

NOTE: The current version of this document is stored in the WPD Corporate Information Database. Any other copy in electronic or printed format may be out of date. Copyright © 2019 Western Power Distribution

IMPLEMENTATION PLAN

Introduction

This document defines the earthing/auxiliary transformers for use within WPD and provides a standard for purchasing to go to tender with.

Main Changes

This is the first issue of this document after separating it from the main transformer specification EE 1

Impact of Changes

The impact of changes affect Purchasing, Primary system design, engineering design and Major Projects.

Implementation Actions

Implementation is immediate

Implementation Timetable

This policy can be implemented with immediate effect

REVISION HISTORY

Document Revision & Review Table		
Date	Comments	Author
February 2019	• First issue	Andrew Reynolds

1.0 General Requirements

This document details requirements for earthing and auxiliary transformers AND SHALL BE READ IN CONJUNCTION WITH THE FULL ENGINEERING SPECIFICATION EE1.

- 1.1 Unless otherwise specified, the type of cooling shall be ONAN as defined in IEC 60076.
- 1.2 The higher voltage terminals will be directly connected to the lower voltage terminals or the tertiary terminals, as applicable, of the associated transmission transformer.
- 1.3 Unless otherwise specified, the fault level at the LV or tertiary terminals of the transmission transformer will be as stated below unless in the Schedule.

System Fault Levels

Table 1:

Nominal System Voltage	kV	66	33	22	11	6.6	0.415
Fault Level	MVA	3,600	1,500	750	400	250	31

- 1.4 The insulation levels shall be in accordance with IEC 60076.
- 1.5 Transformers shall comply with the requirements of IEC 60289 in their ability to withstand short-circuits except that the over-current conditions shall be as defined below and the initial winding temperature shall be the sum of the maximum ambient temperature (40°C) and the temperature rise obtained by the continuous operation at continuous maximum rating (CMR).
- 1.6 When operating at CMR, all transformers shall be capable of withstanding, for 3 seconds, the current occurring when a short circuit is applied between any or all of the lower voltage terminals with full line voltage maintained at the higher voltage terminals.
- 1.7 The guaranteed no-load and load losses of each transformer shall be as stated in the Schedule. Unless otherwise specified they shall be guaranteed subject to the tolerances permitted by IEC 60076.

- 1.8 With the exception of auxiliary transformers having an HV winding rated at <11 kV the sound power level and vibration of all transformers shall comply with Clause 11, of WPD Specification EE 1. The guaranteed sound power value shall be stated by the Tenderer in the Schedule; the measured value shall not exceed the declared value.
- 1.9 The Vector group(s) of all transformers may be such that the voltage of the secondary windings will be in phase with the higher voltage system to which the transmission transformer is connected. Where the transmission transformer is arranged for alternative vector groups, a corresponding arrangement shall be included for the earthing transformer or auxiliary transformer by means of links, which shall be located within the tank and readily accessible through an inspection opening.
- 1.10 When on normal tap, with rated voltage applied between terminals at rated frequency, the magnetic circuit of earthing transformers and auxiliary transformers shall have a flux density not exceeding 1.65 Tesla
- 1.11 The LV windings shall be terminated as follows:-

(i) CMR <550kVA:

Unless otherwise specified in the Schedule the transformer shall be fitted with an approved type of three-pole, air-break, industrial pattern, fully weatherproof, combined switch-fuse incorporating a bolted neutral link and a gland entry for a 4-core cable. No part of the switch-fuse operating handle, when in the closed position, shall be at a height greater than 1.4 m above plinth level and the arrangement for operation shall comply with the safety air clearances detailed. The transformer side of the bolted neutral link shall be earthed to a boss, within the chamber, by a removable connection strap. Removal of the neutral link shall not disrupt the transformer earthing.

(ii) CMR >550kVA:

A cable box as detailed in the Schedule.

Note: Where cable boxes are used, disconnection chambers are not required but, to facilitate cable testing, hand holes shall be provided giving access to the inside of the transformer tank to permit disconnection of the bushings. With the internal connections removed and the bushings covered by at least 50 mm of oil, adequate clearances shall exist to withstand the application of the appropriate cable test voltage.

- 1.12 The following tanks and fittings, complying with this Specification requirements, shall be provided:-
- Conservator
 - Maintenance free de-hydrating breather Pressure relief device
 - Gas and oil actuated relay
 - Oil temperature indicator
 - Winding temperature indicator
- 1.13 Radiators shall comply with the requirements of the specification, with the exception that valves between the radiators and the tank need not be supplied.
- 1.14 Valves shall be fitted in accordance with the requirements of the Specification, except that the combined drain/filter valve and the 'diagonally opposed filter valve', shall be 25 mm.

2.0 Earthing Transformers

- 2.1 The HV windings shall be terminated with bushings or cable boxes as detailed in the Schedule any HV neutral shall be brought out via an oil to air outdoor bushing not a Euromold type bushing unless otherwise specified.
- 2.2 The rated short time current through the HV neutral unless otherwise stated shall be as given below:-

Table 2:

Voltage	kV	6.6	11	22	33	66
Rated short-time current (30 seconds)	Amp	1,320	1,050	750	750	500

- 2.3 When operating at CMR of the secondary winding, the HV winding shall be capable of withstanding, simultaneously, the rated short-time current and, for 3 seconds, the current obtained with a short-circuit applied between one HV line terminal and the HV neutral terminal with full line voltage maintained at the HV line terminals.
- 2.4 Lower voltage windings shall be provided to give a 415/230 volt, 3 phase, 4 wire supply - unless this requirement is specifically excluded in the Schedule.
- 2.5 Unless a higher rating is specified by the Purchaser the standard rating for the lower voltage winding of earthing transformers shall be 200 kVA.
- 2.6 Unless specified by the Purchaser the declared HV/LV impedance for earthing transformers shall not exceed the value given for auxiliary transformers of equal rating, see Table 3 below.
- 2.7 All CTs shall be externally mounted and not located within the tank this will facilitate easier testing. These shall be specified at time of tender and supplied by the manufacturer allowing a suitable mounting arrangement to be manufactured to support these CTs.

Table 3: Standard Auxiliary and Earthing Transformer Ratings.

	No-load Voltage Ratio (kV)	Continuous Maximum Rating (kVA)	Impedance at CMR at 75°C (%)
Auxiliary Transformers	6.6/0.415 or 11/0.415	200	4.75
		400	4.75
		500	4.75
		800	4.75
		1,000	4.75
	22/0.415 or 33/0.415	200	5.5
		400	5.5
		500	5.5
		800	5.5
		1,000	5.5
	66/0.415	200	6.0
		400	6.0
		500	6.0
		800	6.0
		1,000	6.0
Earthing Transformers	11/0.415	)	See Clause 2.1.6
	22/0.415	) 200	
	33/0.415	) See Clause	
	or	) 2.1.5	
	66/0.415	)	

- 2.8 The zero sequence impedance of the HV winding may be specified, by the Purchaser, to have a minimum value. The guaranteed value shall be stated by the Tenderer in the schedule. The measured value shall be within the range plus 20% and minus zero of the guaranteed value.
- 2.9 The impedance between the higher and lower voltage windings shall comply with the requirements of Table 3; the guaranteed value shall be stated by the Tenderer in the Schedule.
- 2.10 The Vector group symbol shall be Zyl with changeover links provided on the lower voltage winding to permit reconnection equivalent to Zyll.
- 2.11 A thermometer pocket shall be provided.
- 2.11 A self-dehydrating breather shall be supplied.

3.0 Auxiliary Transformers

- 3.1 The HV windings shall be fitted with bushings or cable boxes as detailed under item in the Schedule
- 3.2 The CMR and the voltage ratio shall be as specified under the Schedule chosen from the standard ratings and voltage ratios listed in Table 17.
- 3.3 Transformers having their HV winding rated at <11kV, shall have a sound power level of less than 63dBA.
- 3.4 Unless otherwise specified, the impedance between the higher and lower voltage windings shall be as specified in Table 3, subject to the tolerances permitted by IEC 60076.
- 3.5 Unless otherwise required for compliance with the Schedule or Clause 1.1.9, the Vector symbol shall be DzO with changeover links on the higher voltage winding to permit reconnection to Dz6.
- 3.6 A thermometer pocket shall be provided.
- 3.7 A self-dehydrating breather shall be supplied

4.0 Neutral Coupler

- 4.1 A neutral coupler shall be supplied with all Earthing/Auxiliary transformers and shall be matched to that transformer. The neutral coupler shall be designed to limit the rise of phase to neutral voltage under system earth fault conditions. It shall comply with all relevant sections of this Specification.
- 4.2 The Neutral Coupler shall have the following characteristics
 - a) Vector Symbol: Zn
 - b) Rated Power: 66.7kVA
 - c) Rated Voltage: 415V
 - d) Rated Current: 92.7A, continuous
 - e) Rated Neutral Current: 278A, continuous
 - f) Zero sequence impedance per phase: 0.027 Ω
 - g) Insulation level: 50Hz withstand: 3kV rms

Alternative ratings may be specified, at time of tender, where a neutral coupler is being purchased to match an existing earthing transformer.

- Figure A1 - Earthing transformer mounted arrangement**

Figure A2 - Plinth-mounted, Arrangement A


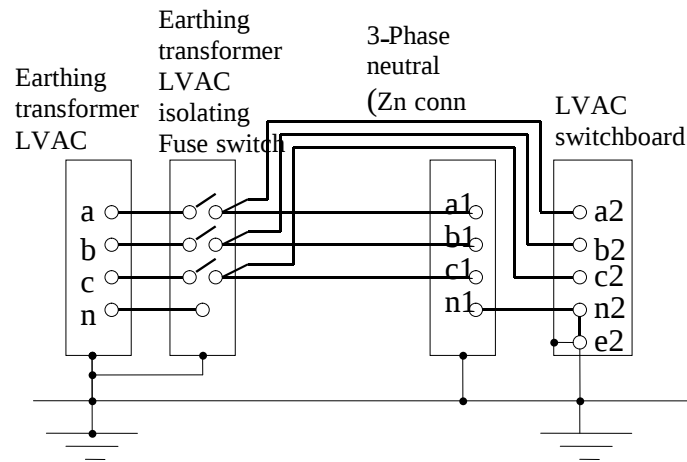


Figure 2A Plinth mounted, Arrangement B

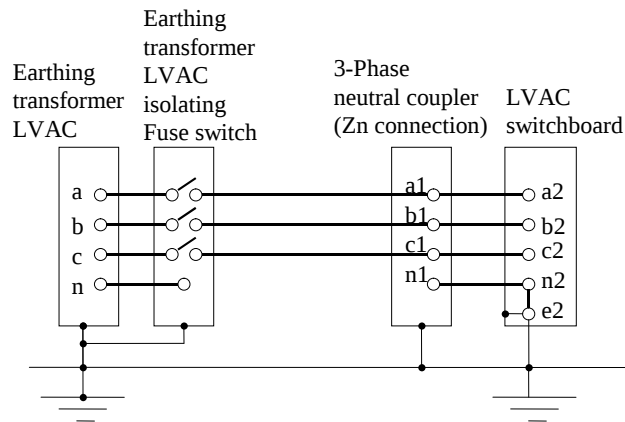

APPENDIX A

SUPERSEDED DOCUMENTATION

None

APPENDIX B

ASSOCIATED DOCUMENTATION

EE 1

APPENDIX C

IMPACT ON COMPANY POLICY

None

APPENDIX D

KEY WORDS

Earthing Auxiliary