
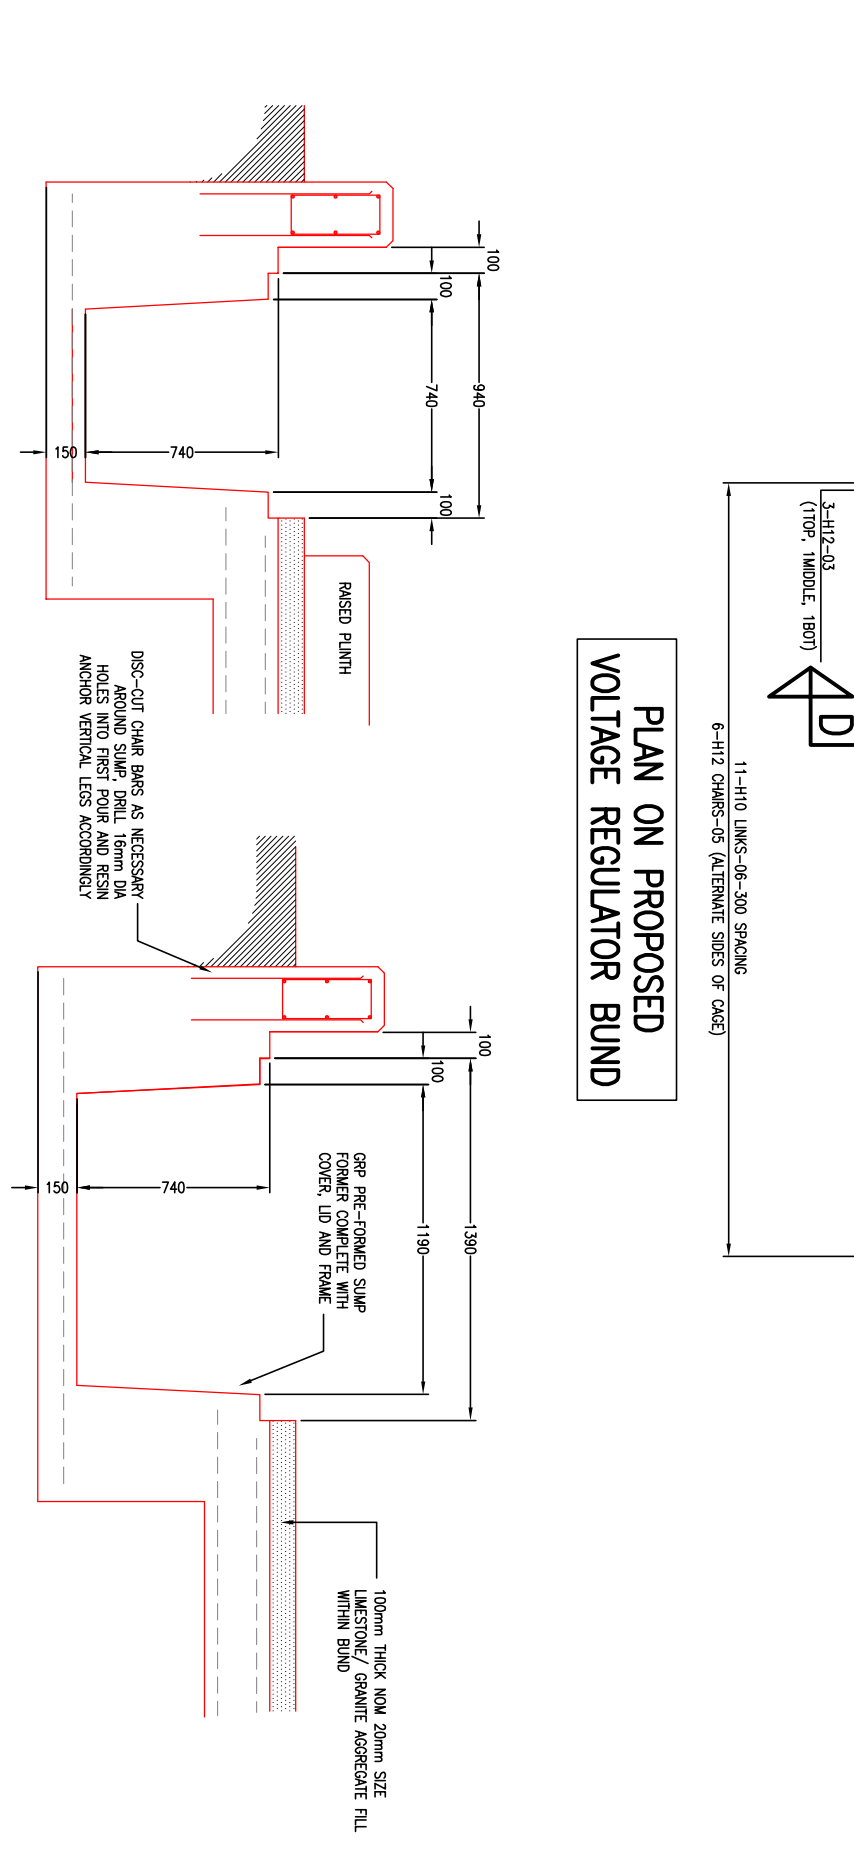
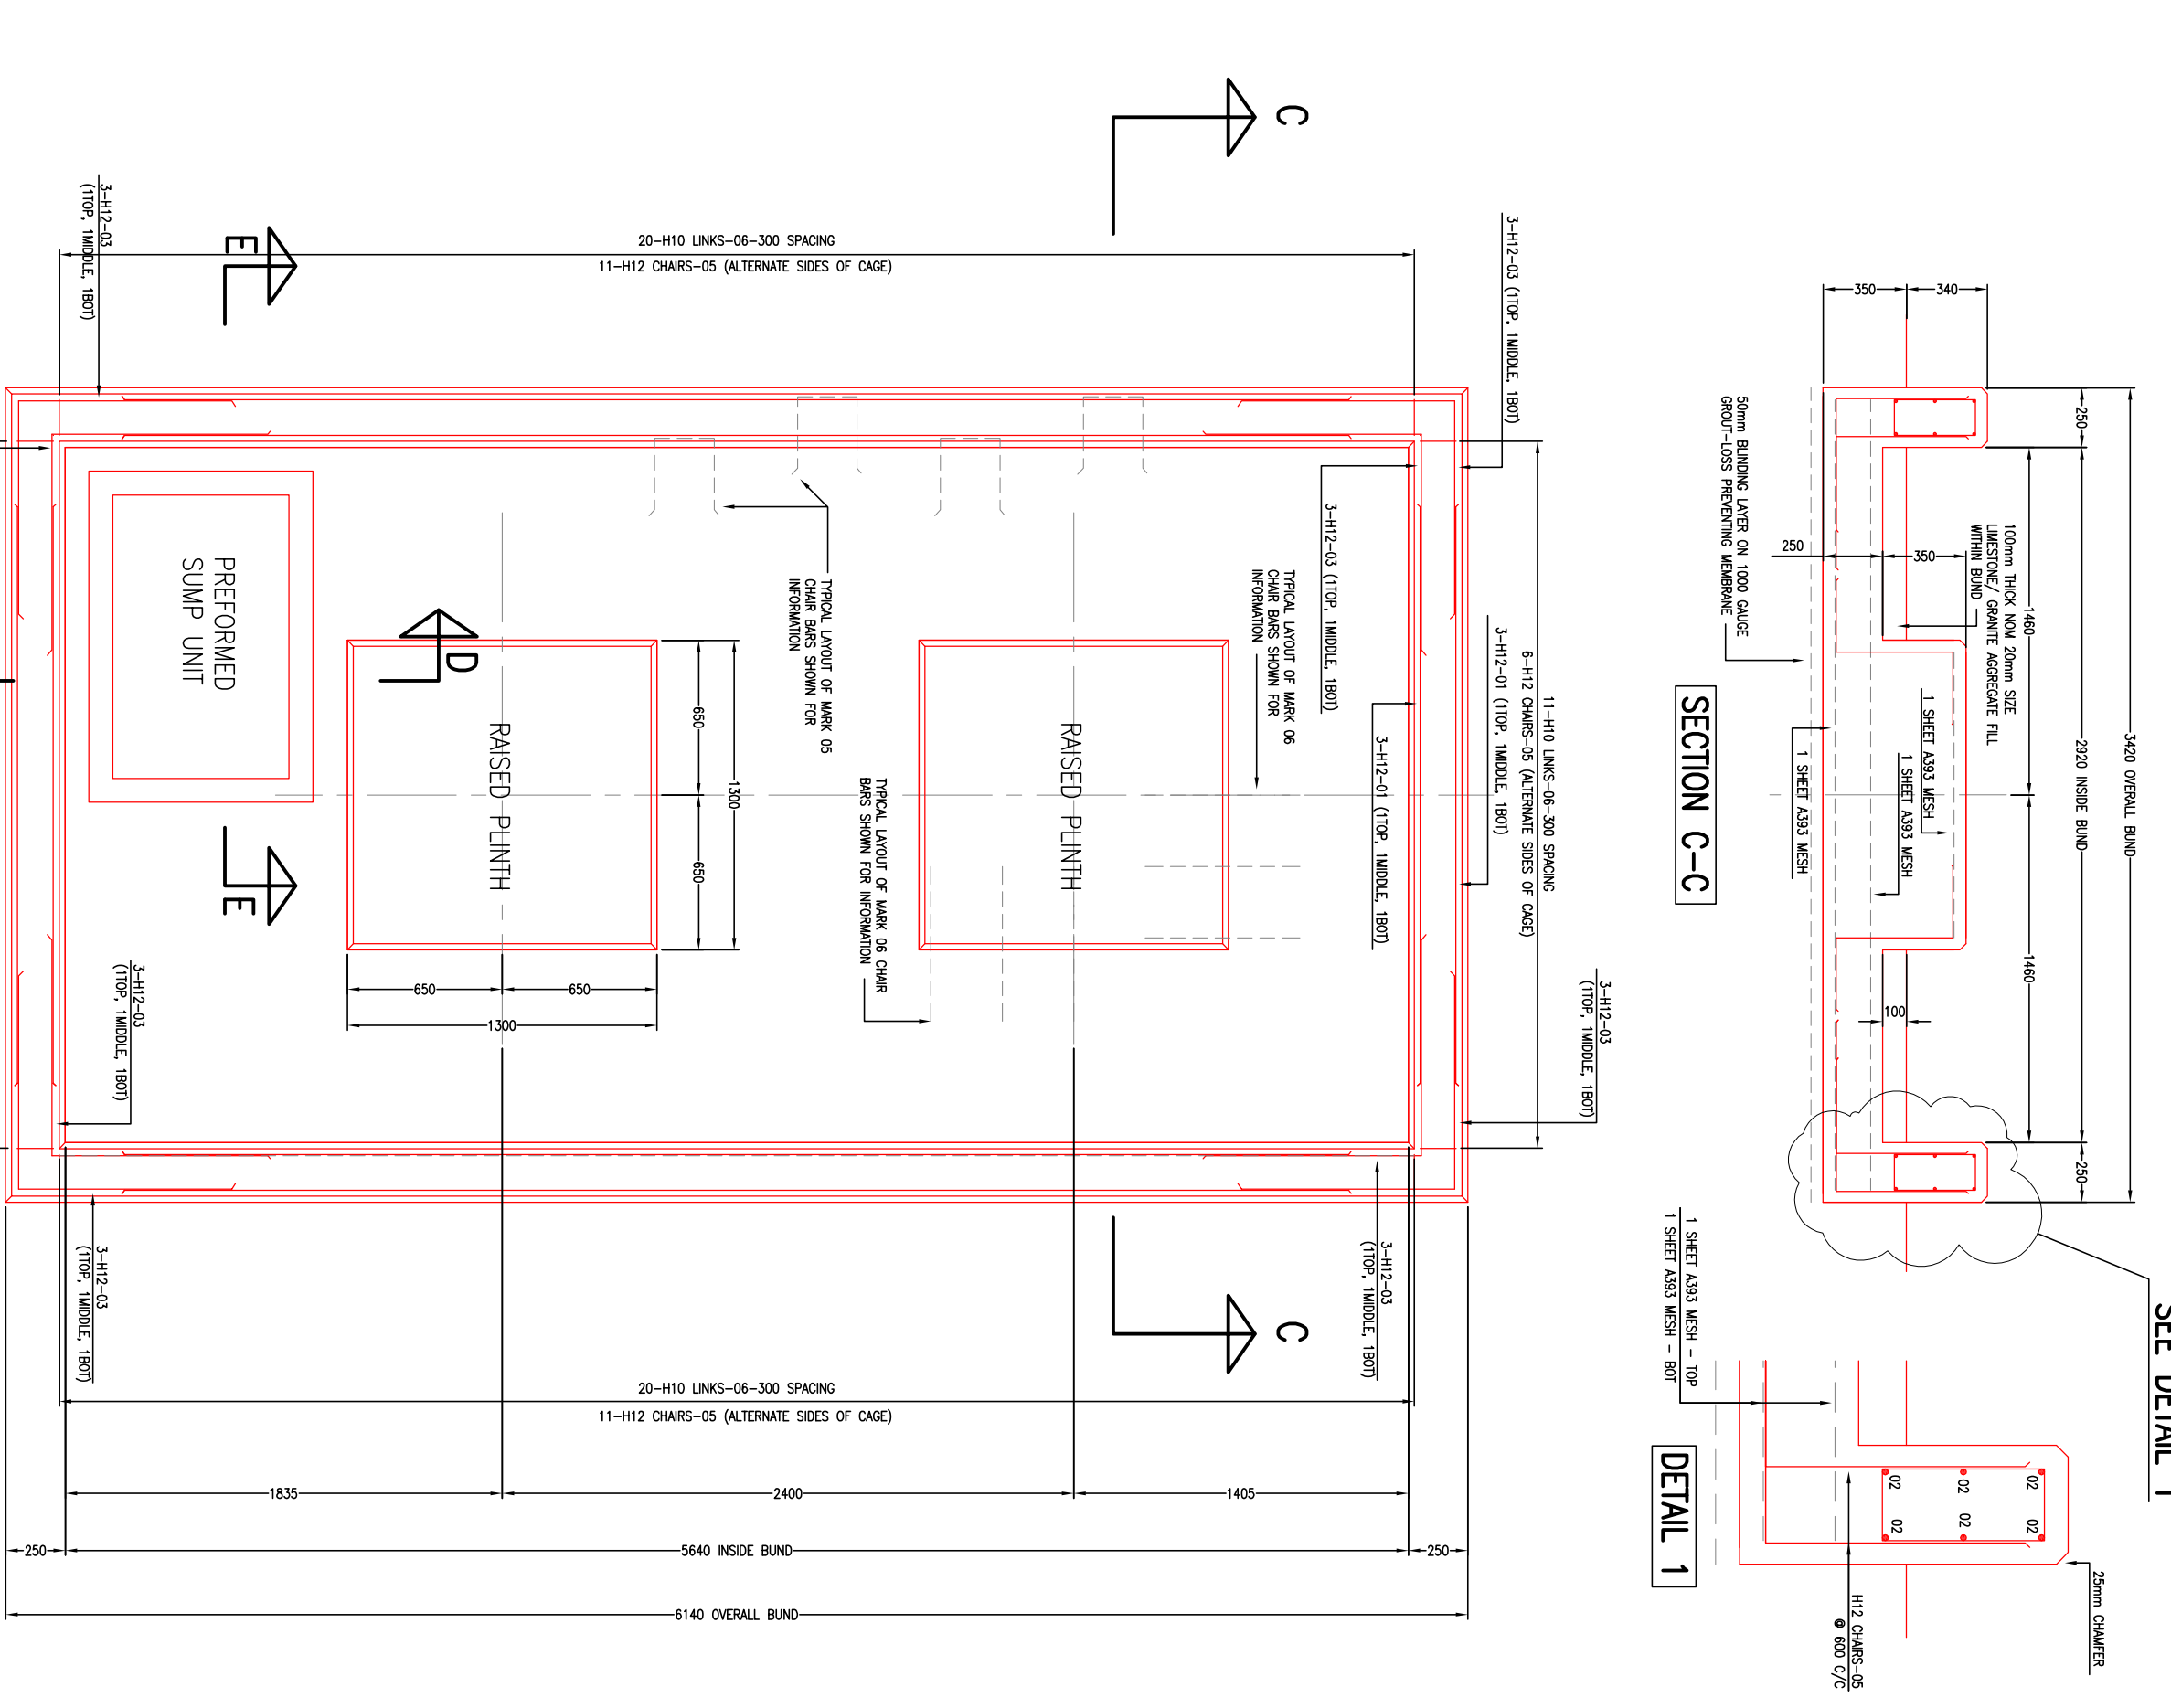
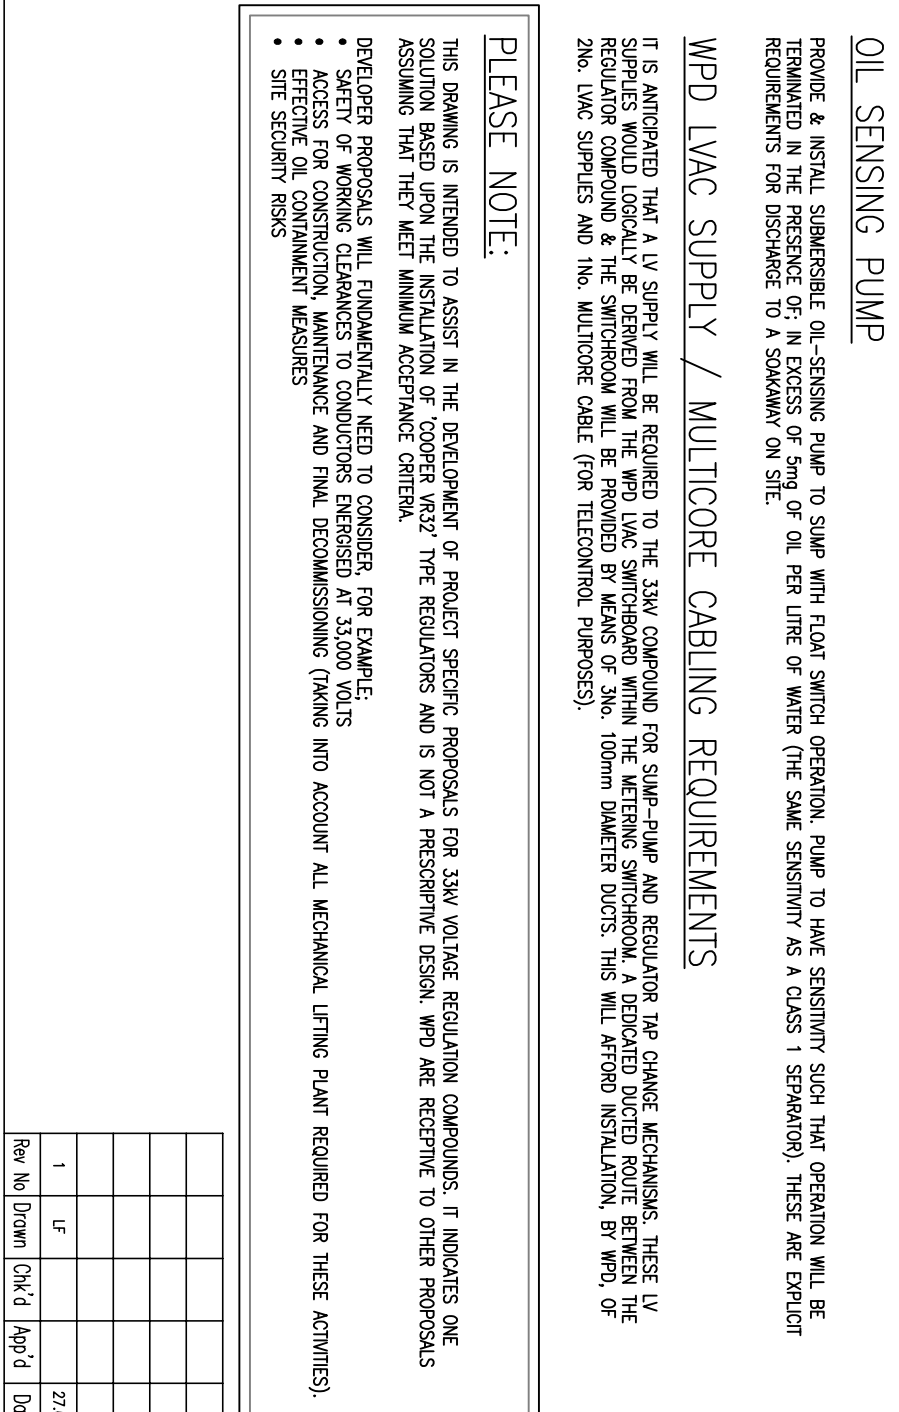
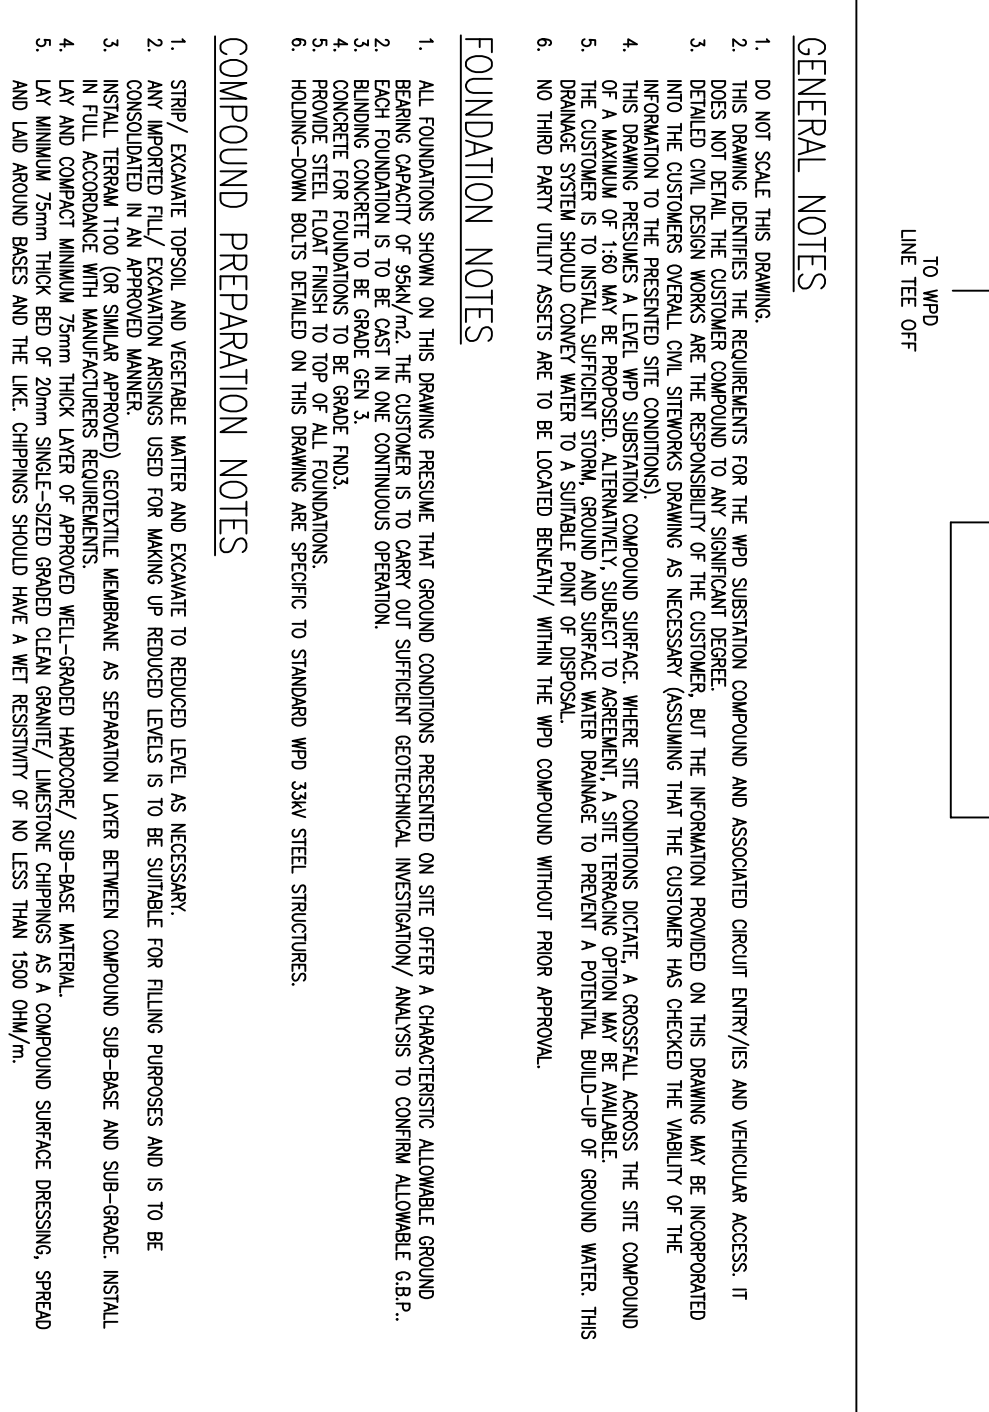
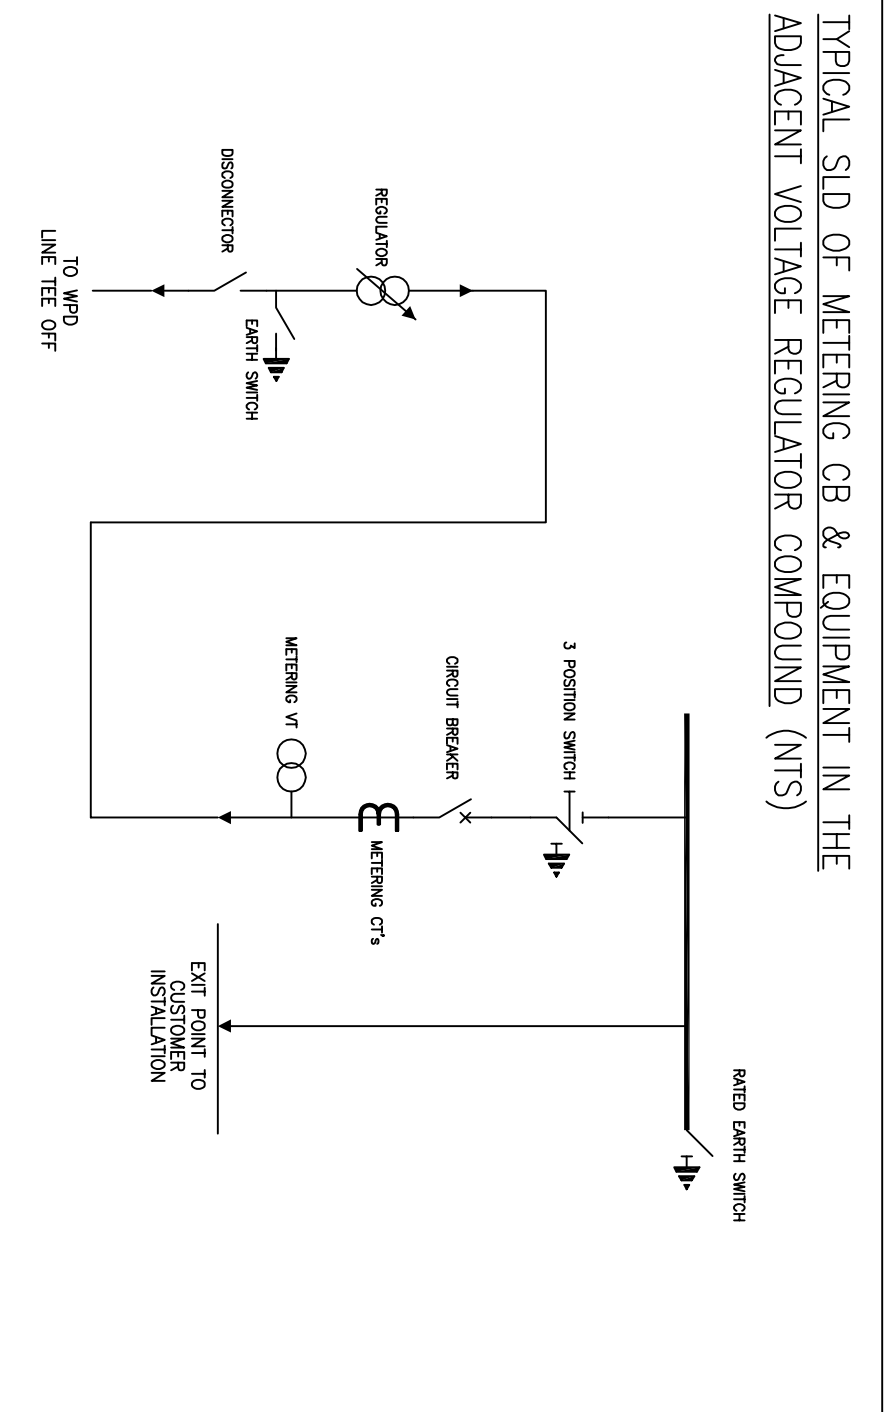


## VOLTAGE REGULATOR BUND DETAILS (1:20)

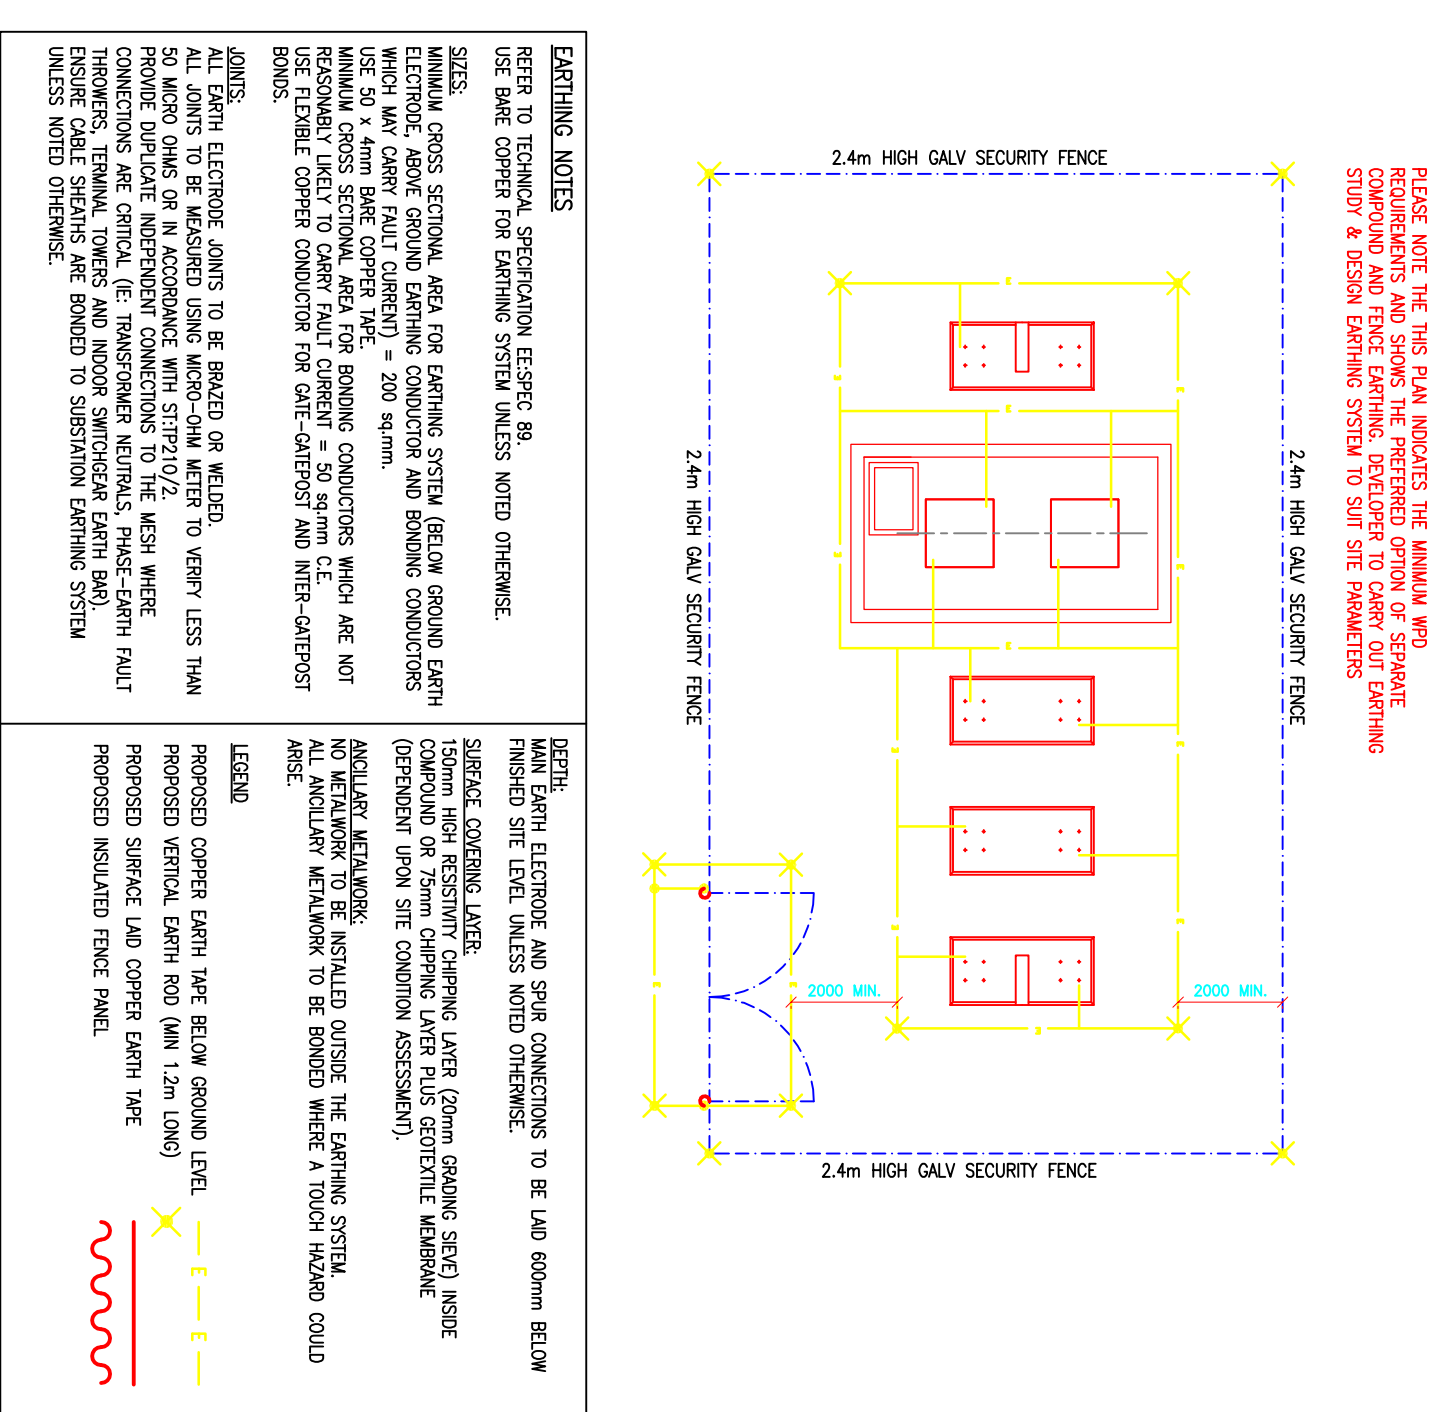

SECTION D-D

SECTION E-E

REINFORCEMENT BENDING SCHEDULE

BAR MARK	TYPE & SIZE	TOTAL NUMBER	LENGTH	SHAPE CODE	A (mm)	B (mm)	C (mm)
01	H12	12	2500	00	2500		
02	H12	12	5200	00	5200		
03	H12	24	1800	11	900	(830)	
04	H10	62	1150	51	340	150	(110)
05	H12	34	1700	99	250	500	300
06	H12	48	1000	23	1000	300	(300)
MESH	A393	6 SHEETS	480mm x 240mm				

The diagram illustrates a structural cross-section with reinforcement details. It features a central horizontal reinforcement bar with a length dimension of 8-500. On the right side, there is a vertical reinforcement bar with a height dimension of 1400. At the bottom left, there is a diagonal reinforcement bar with a height dimension of 400. The reinforcement is shown in red lines against a black structural outline.

ORIGINAL, ISSUE		1061	
Drawn	U	20.01.13	
Checked			
Approved			
SCALE: 1:50, 1:20 & 1:10			
* NO PAPER SIZE			
UNITS STANDARD BRITISH (SI) DIMENSIONS AND TOLERANCES			
Revision			
WESTERN POWER DISTRIBUTION Design Department Ayrbank Road, Glasgow G8 7PB Tel: 0117 933 2000 Fax: 0117 933 2001.		WESTERN POWER DISTRIBUTION	
The		Brg. No.	
SITE WORKS TO ENFORCE 33KV VOLTAGE REGULATOR SW		GCS0018	
		Rev. No.	
		1	