


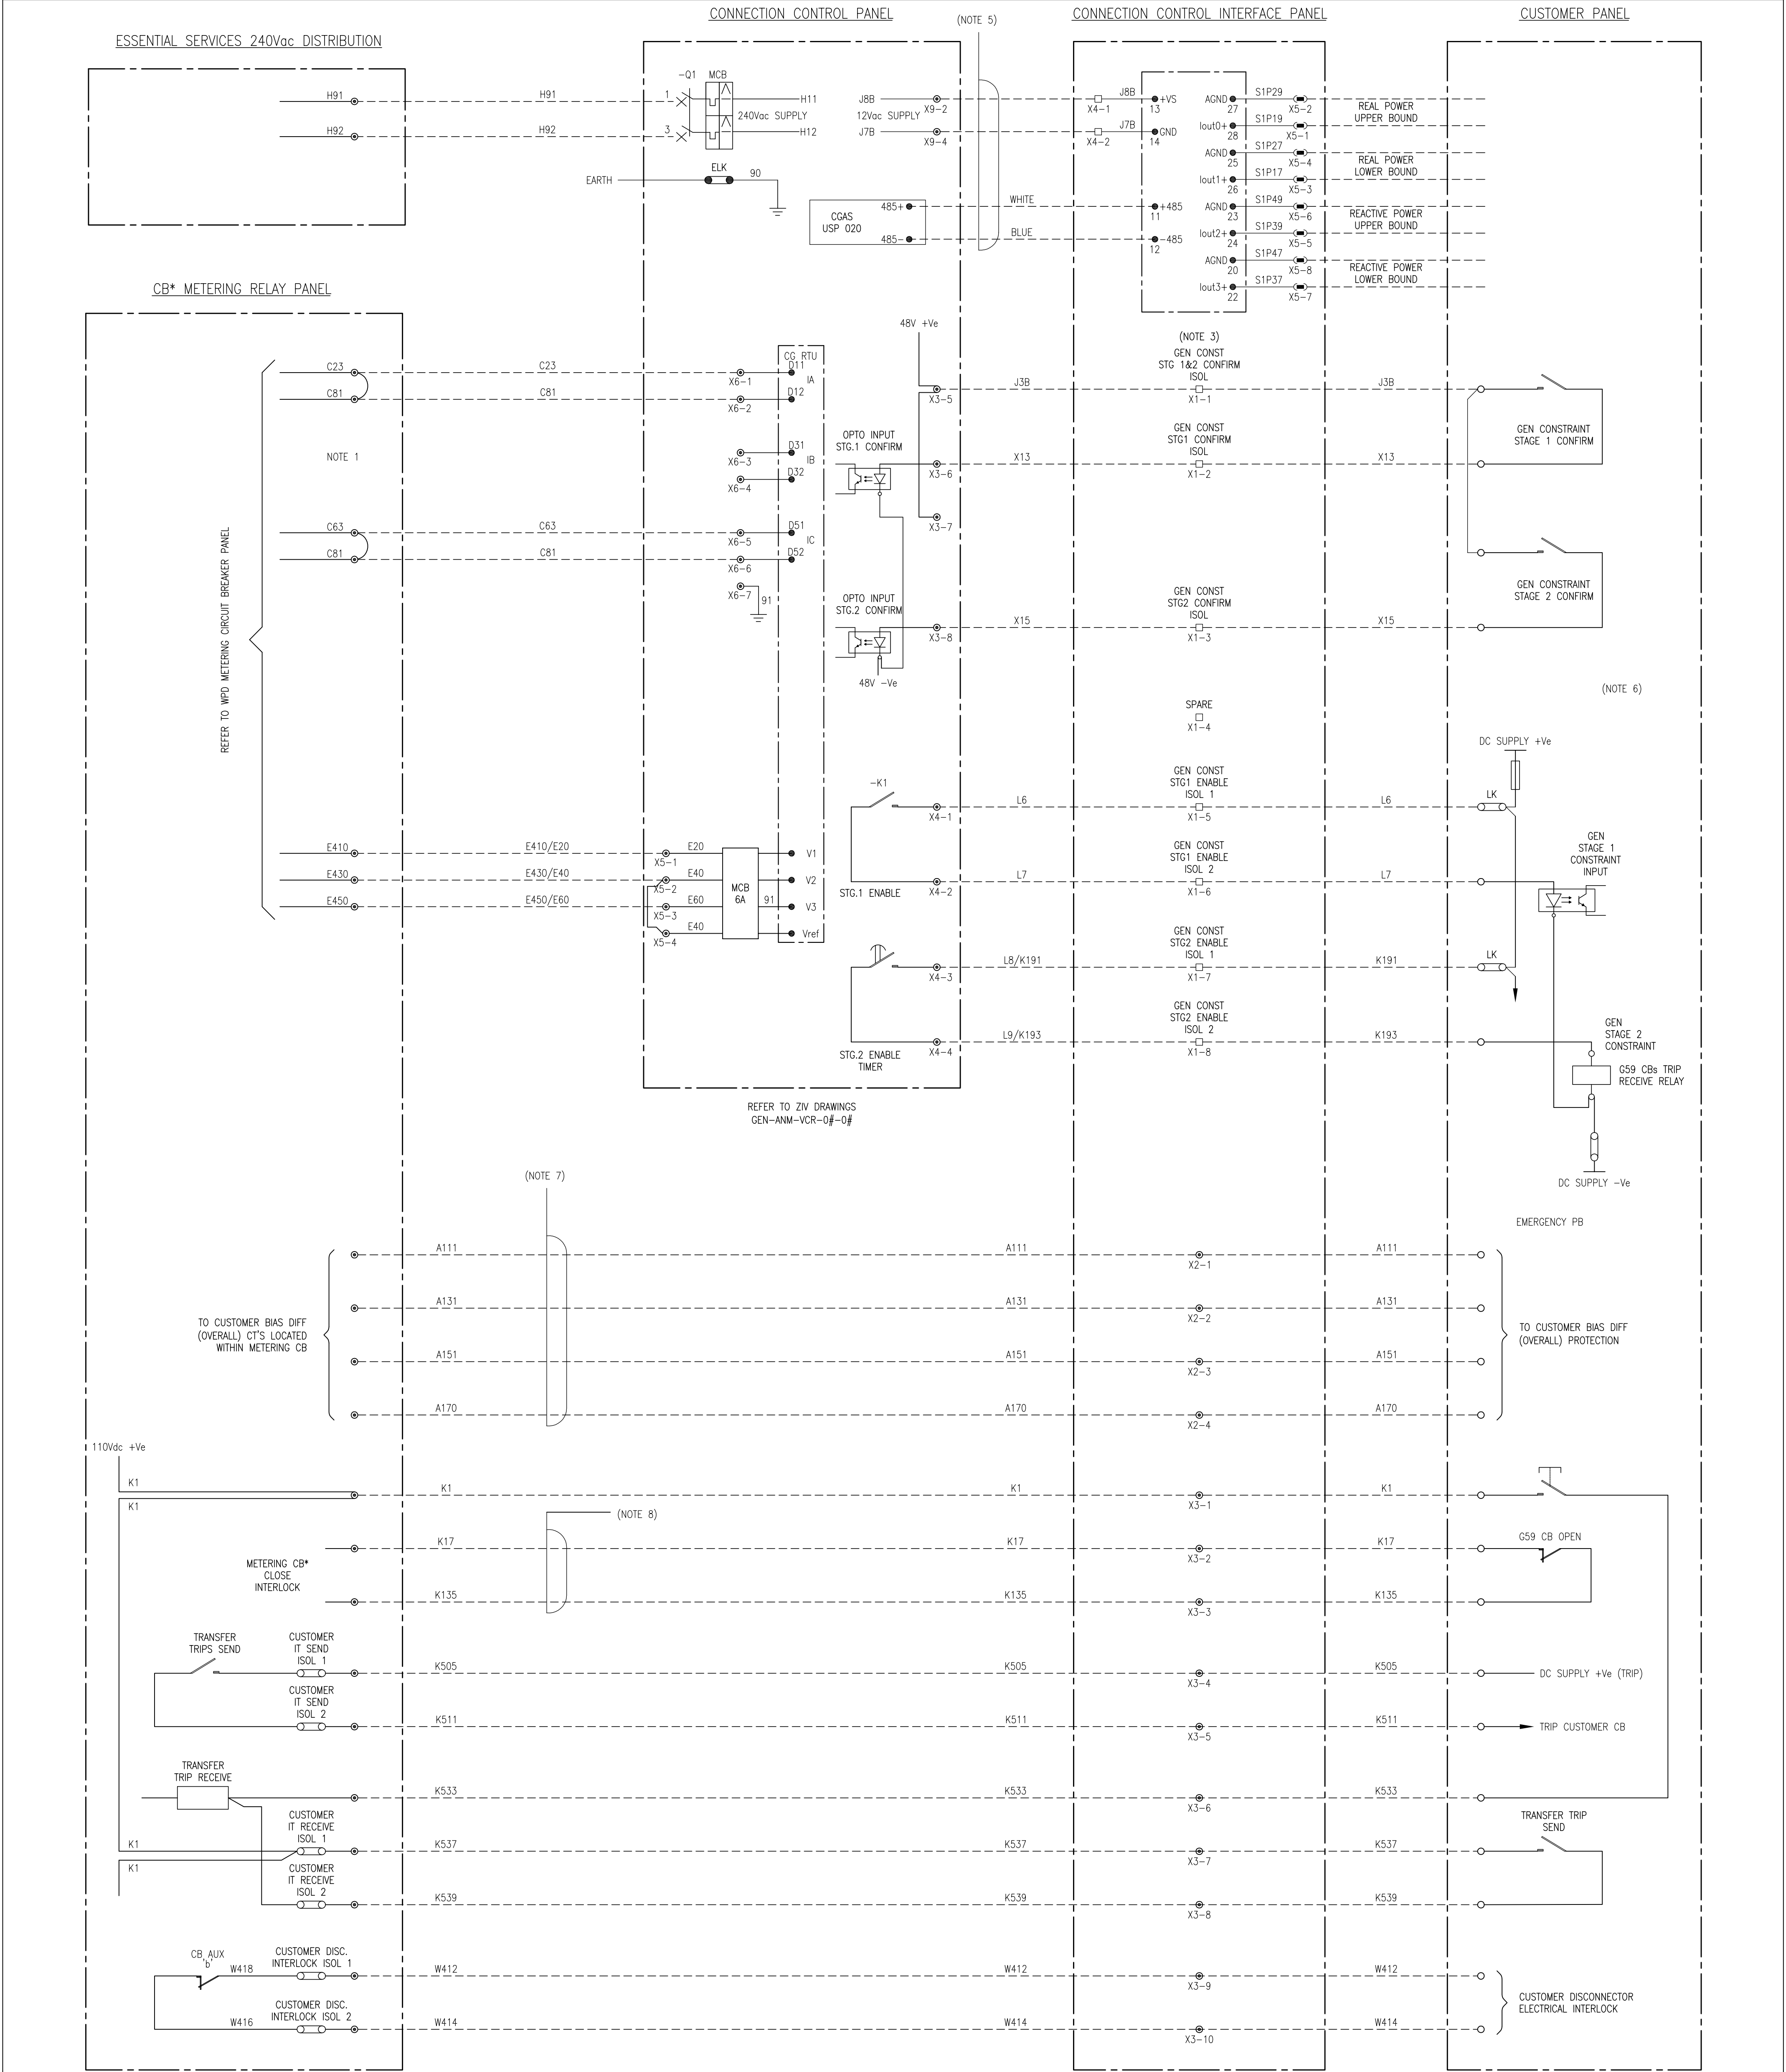

- NOTES:
1. CT SHORTING LINKS TO BE REMOVED IN THE WPD METERING CB PANEL.
 2. WPD INTERFACE DRAWINGS FROM THE CONNECTION CONTROL PANEL ARE REFERENCED ON WPD DRAWINGS AS EITHER: SOFT INTERTRIP, VOLTAGE CONSTRAINT OR GENERATOR CONSTRAINT.
 3. CONSTRAINT ISOLATION LINKS ARE TERMINAL BLOCK PULL LINKS TYPE RSF2, DENOTED AS □. SEE CONNECTION CONTROL INTERFACE PANEL -X1.
 4. CCP TERMINAL BLOCKS ARE A MIXTURE OF FLIP LINKS & SCREW CLAMP TERMINALS BUT DENOTED AS ● FOR EASE.
 5. CONNECTION CONTROL PANEL TO CONNECTION CONTROL INTERFACE PANEL INTER-PANEL CABLES ARE SUPPLIED LOOSE WITH CCP/CCPIF PANEL EQUIPMENT, AND ARE TO BE CONNECTED ON SITE.
 6. CUSTOMER DESIGN TO MANAGE AND CATER FOR THE ADDITION OF ISOLATION LINKS WITHIN THE CUSTOMER PANEL/EQUIPMENT TO CATER FOR FERRULING INTERFACE FROM CONNECTION CONTROL INTERFACE PANEL TO CUSTOMER END EQUIPMENT AS REQUIRED.
 7. CT CONNECTION TO CUSTOMER OVERALL PROTECTION (WHERE REQUIRED).
 8. CONTACT AND FERRULE REQUIREMENT WILL DEPEND ON CONNECTION REQUIREMENT AND SELECTED CB SUPPLIER SCHEMATIC DESIGNS.

							ORIGINAL ISSUE	Date	WESTERN POWER DISTRIBUTION Design Department. Avonbank, Feeder Road, Bristol BS2 0TB Tel: 0117 933 2000 Fax: 0117 933 2001. WESTERN POWER DISTRIBUTION			
							Drawn	GE				10.08.16
							Checked					
							Approved					
1	MJW	FXO	GB	09.05.18	AMENDMENTS MADE TO REFLECT USE OF ZIV CONNECTION CONTROL PANEL		SCALE:	NTS		Title SCHEMATIC DIAGRAM OF INTERFACE ARRANGEMENT FOR CUSTOMER CONTROL PANEL – 132kV CONNECTIONS	Drg. No. 132CCP–SCHEME	Rev No. 1
Rev No	Drawn	Chk'd	App'd	Date	Revision							

ALL RIGHTS ARE RESERVED TO WPD (Solely owned) and no part of this drawing may be reproduced or transmitted in any form or by any means, including photocopying and recording, or stored in a retrieval system or any website without permission.