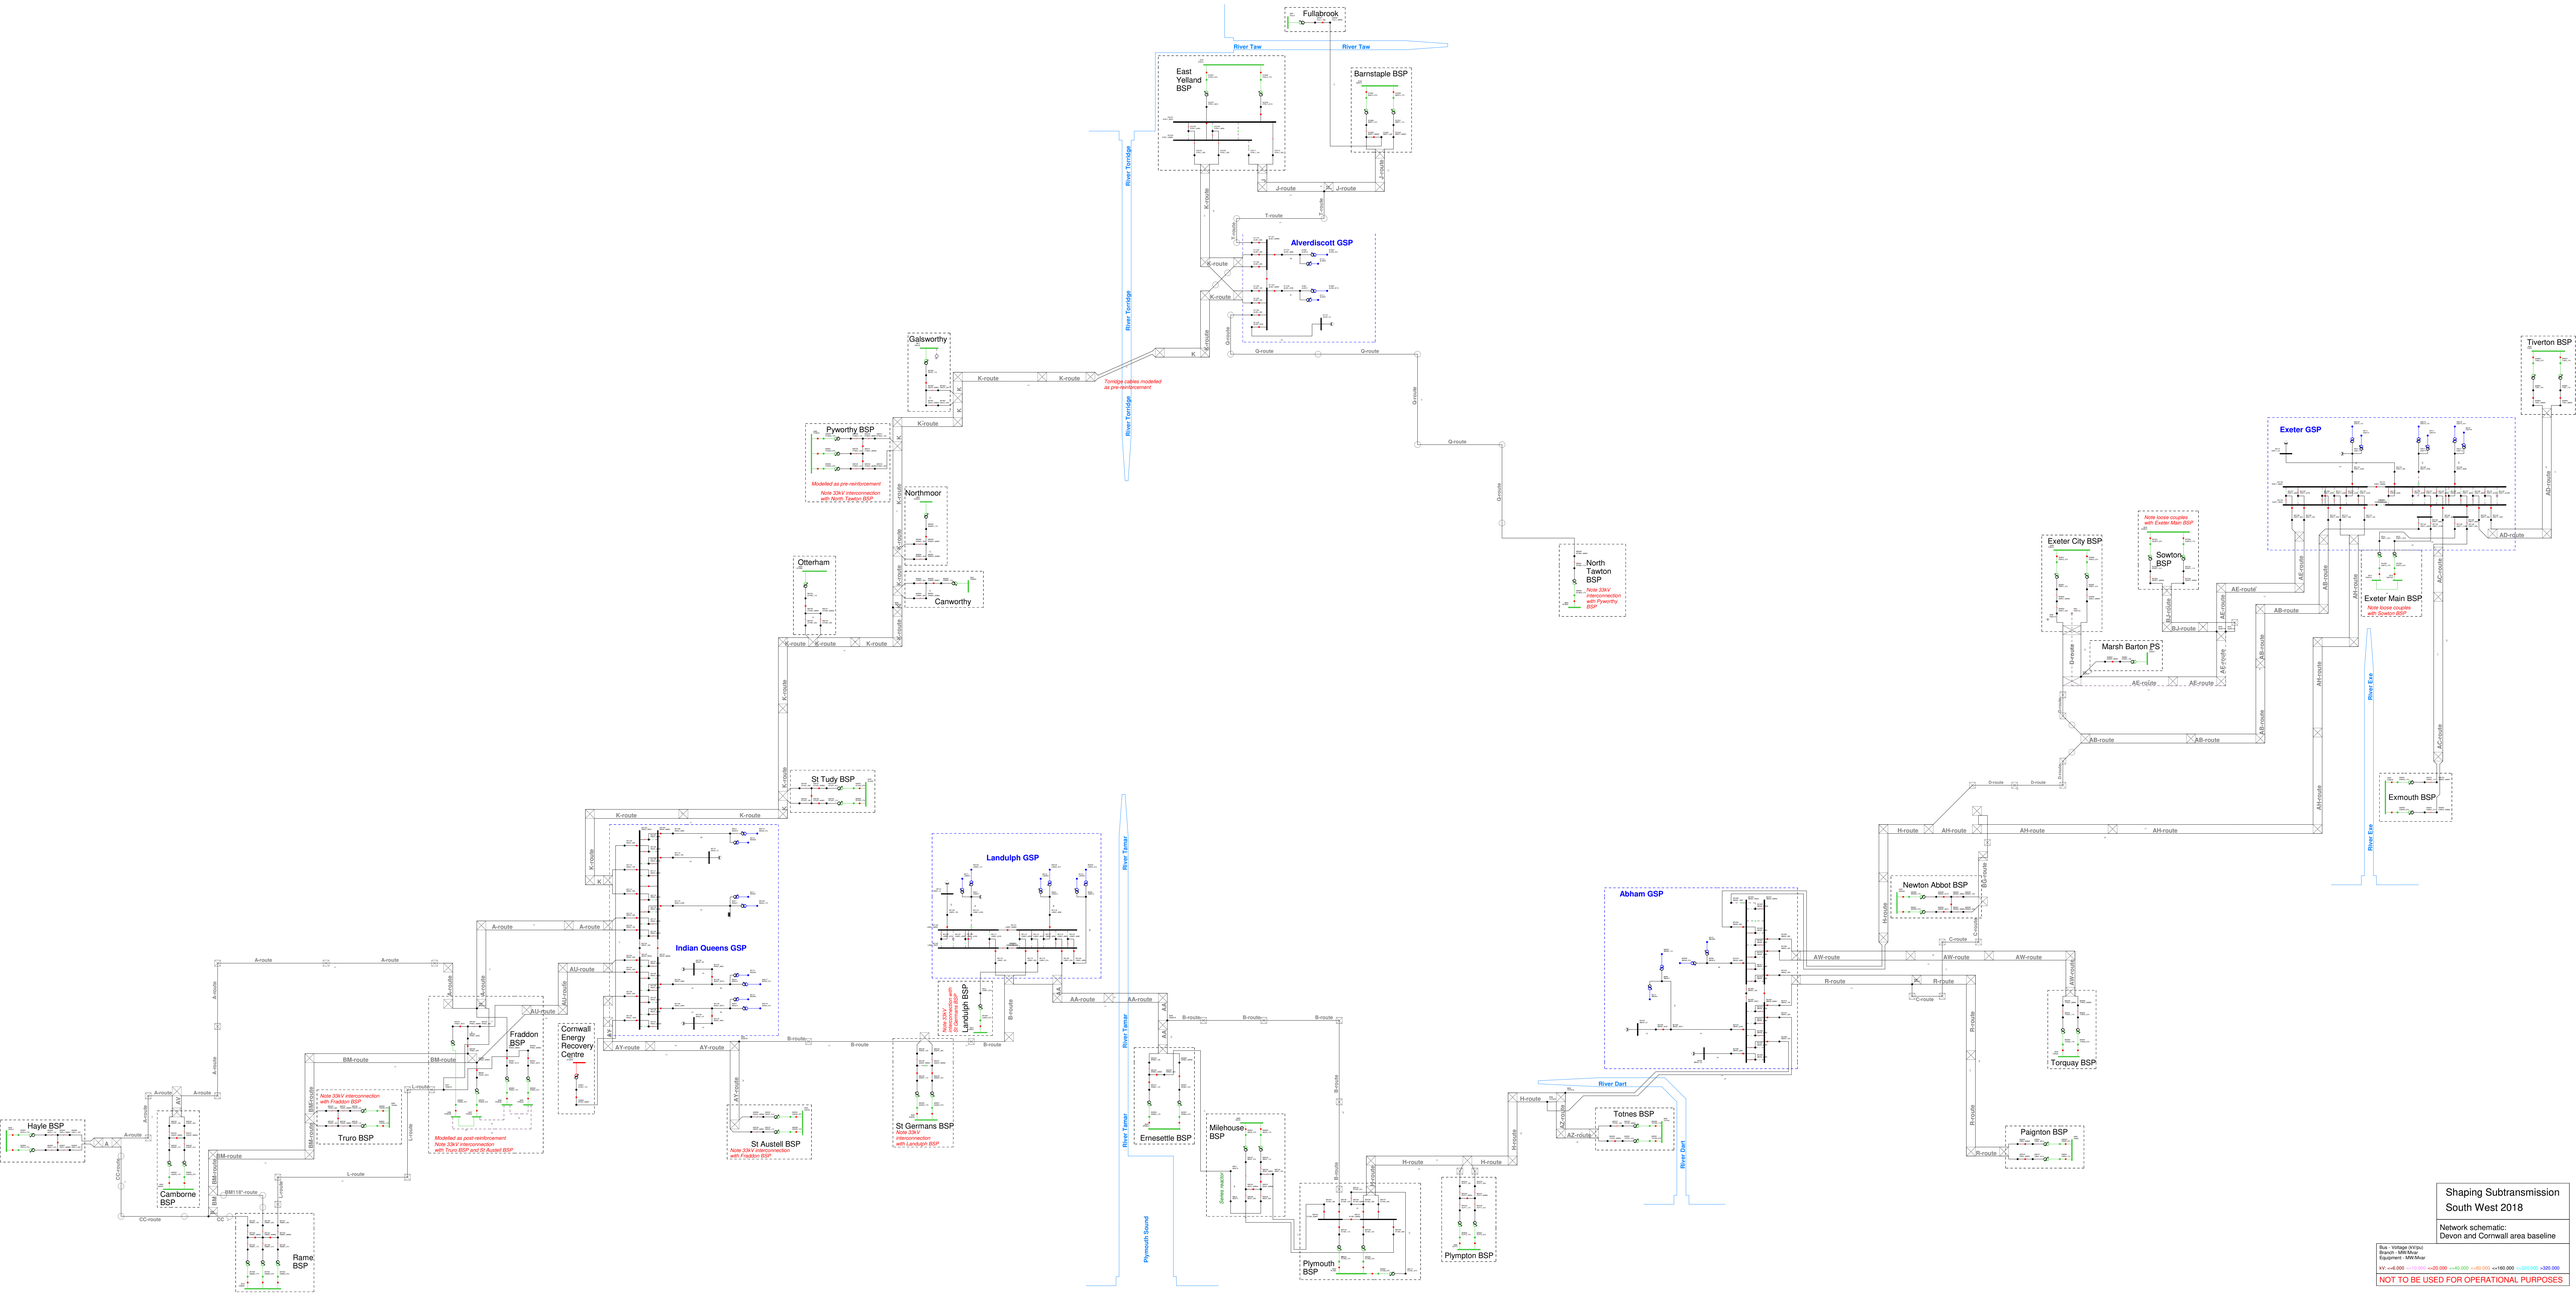

Shaping Subtransmission South West 2018

Network schematic: Devon and Cornwall area baseline

Bus - Voltage (kV)(s)
Branch - MW/Mvar
Equipment - MW/Mvar

kV: <=0.000 <=10.000 <=20.000 <=40.000 <=66.000 <=132.000 <=275.000 >275.000

NOT TO BE USED FOR OPERATIONAL PURPOSES