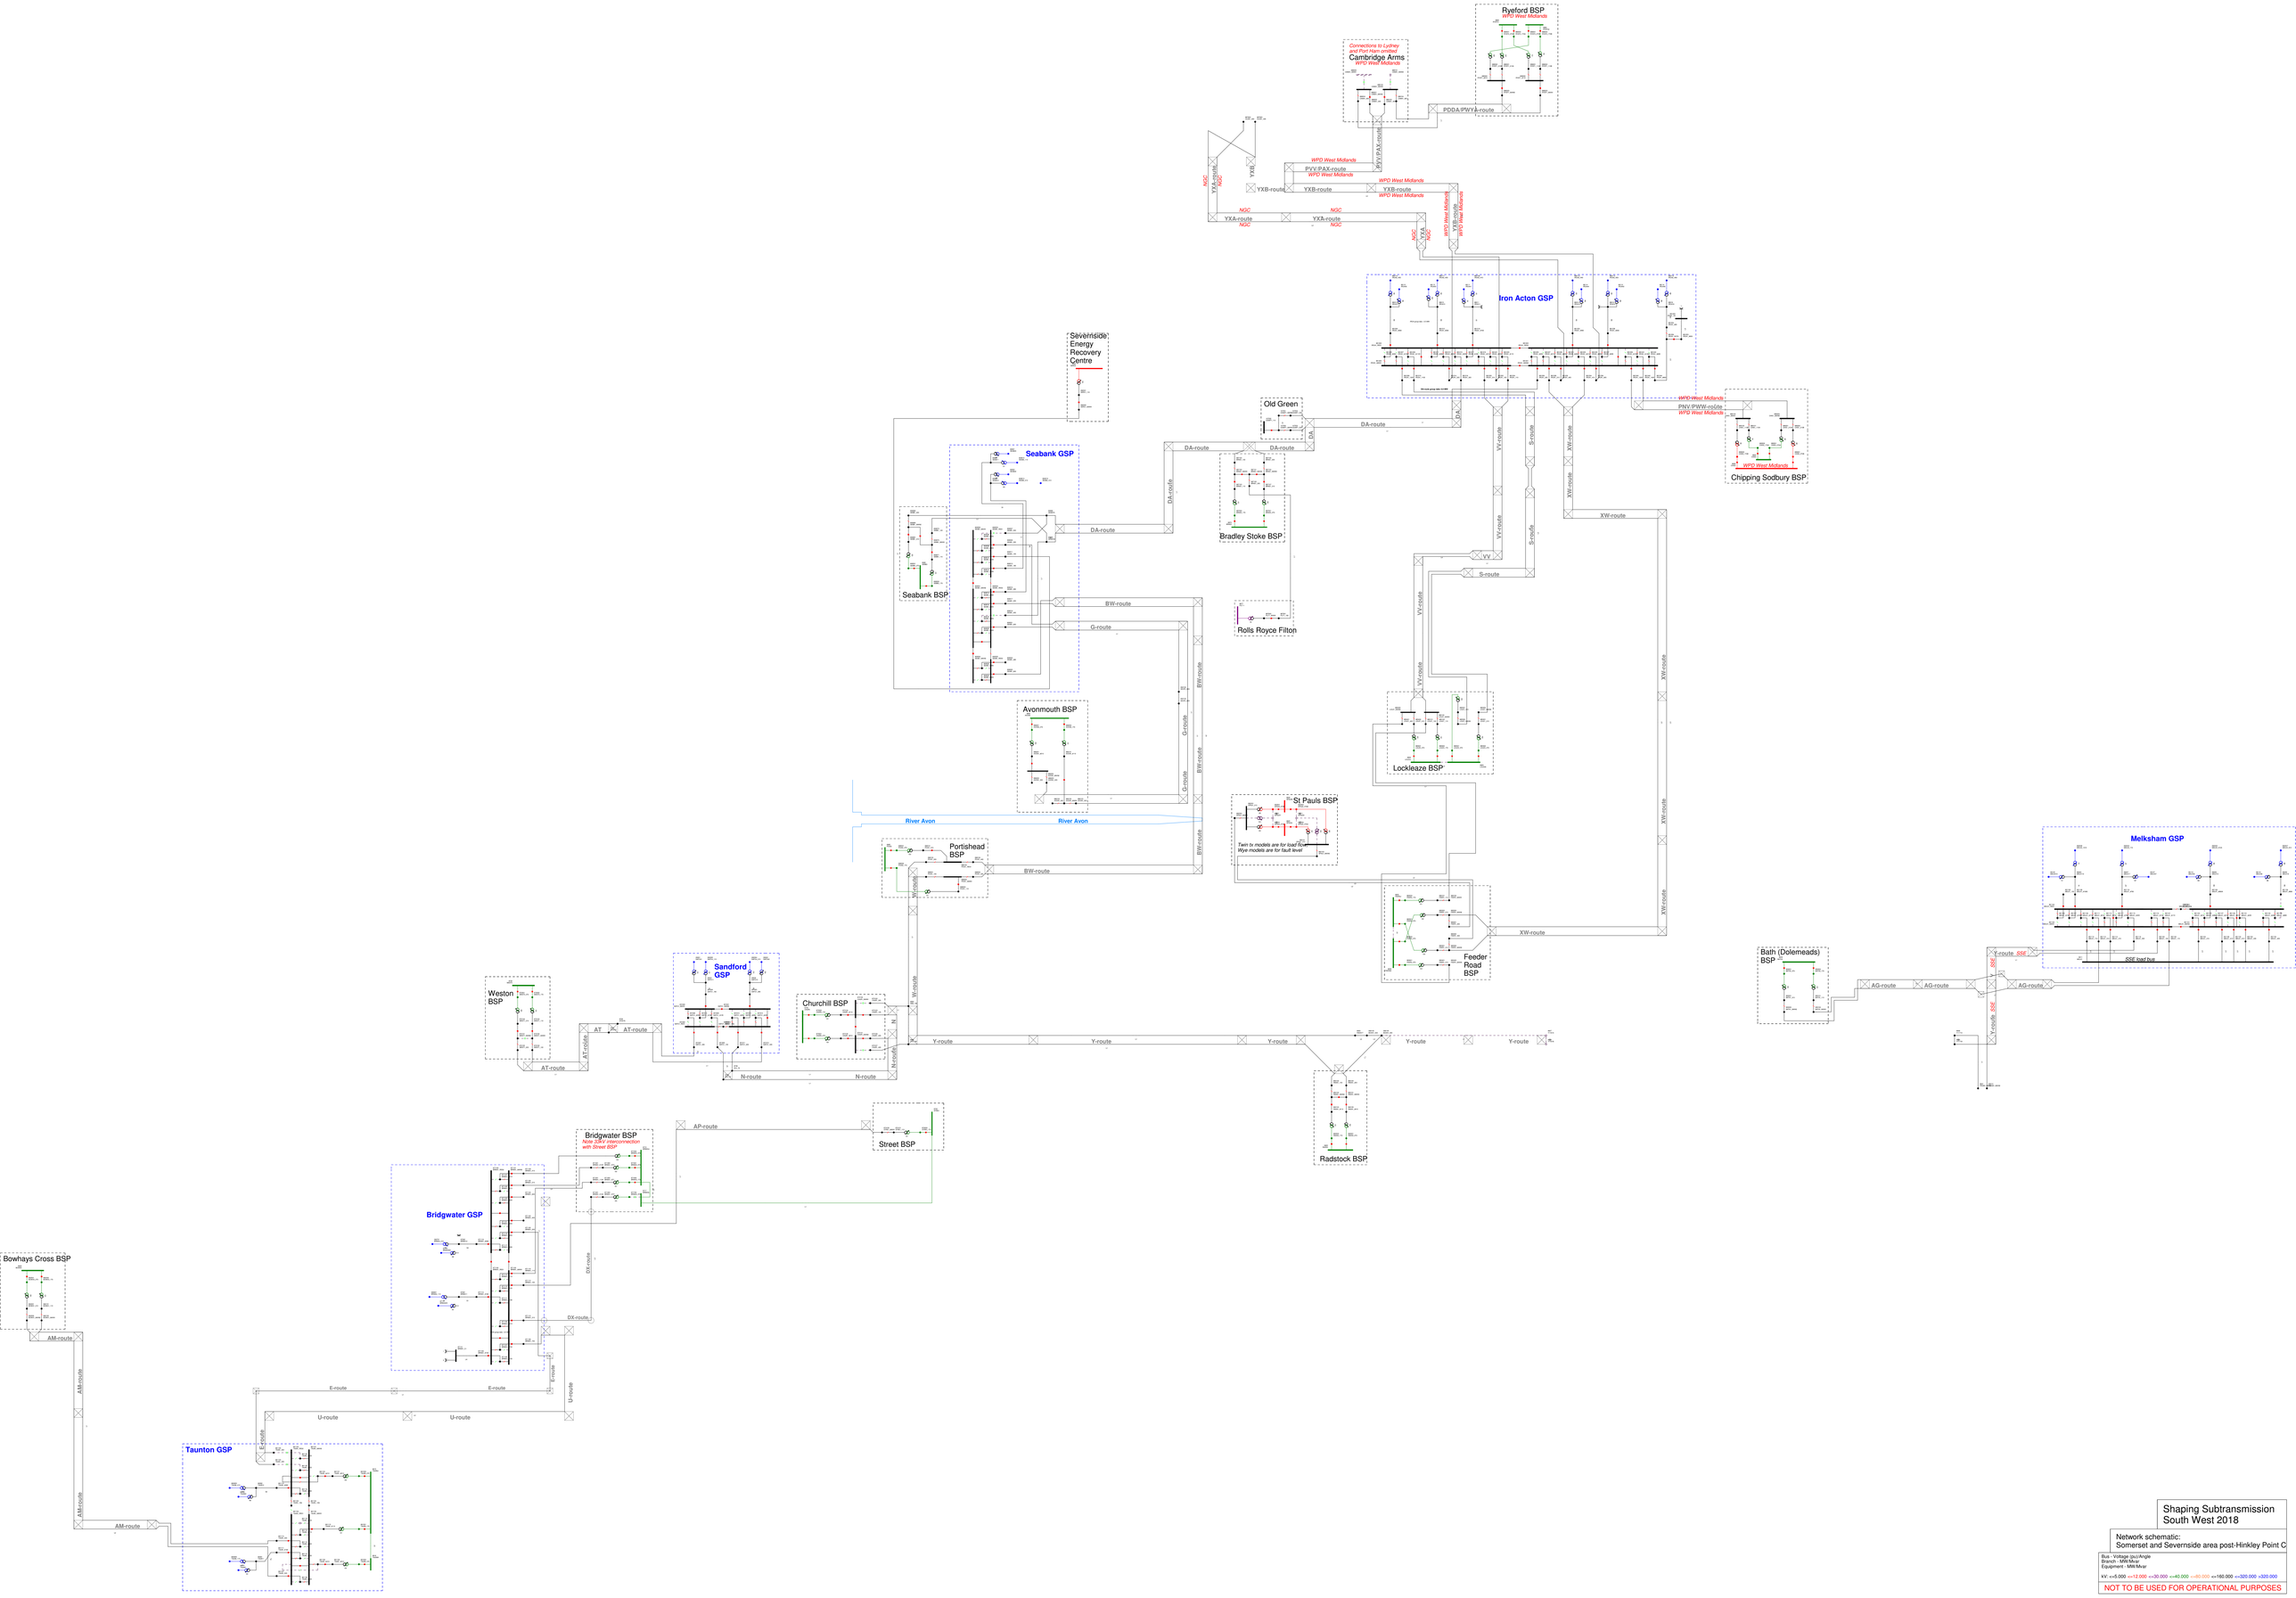

Shaping Subtransmission
South West 2018

Network schematic:
Somerset and Severnside area post-Hinkley Point C

Bus - Voltage (pu)/Angle
Branch - MW/Mvar
Equipment - MW/Mvar

kV: <=5.000 <=12.000 <=30.000 <=40.000 <=60.000 <=160.000 <=320.000 >320.000

NOT TO BE USED FOR OPERATIONAL PURPOSES